

Client name & address:	PHH Environmental, F10 Forgeside House, Cardiff Bay Business Centre, Lewis Road, Cardiff, CF24 5FA		
Site:	Abertonnllwyd House, Abertonnllwyd Street, Treherbert, Treorchy, CF42 5PQ		
Removal contractor / supervisor:	As client / Richard Barrett		
Sampled by:	Geraint Sage	Date:	01/06/21
Scope of works:	Reassurance testing in ground floor foyer (sample 1), first floor hallway (sample 2) and flats 4, 6, 11 & 13 (samples 3-6) following removal of asbestos-containing textured ceiling coatings		

All testing carried out in accordance with in-house procedures based on HSG248 - *The analysts' guide for sampling, analysis & clearance procedures*.
Opinions and interpretations expressed herein are outside the scope of UKAS accreditation.

Exposed filter diameter:	22 mm	Timer ID:	TP1	Flow meter ID:	FMH4	Microscope:	M4
NPL test slide ID:	TS1	5th band observed?	Yes	Micrometer ID:	SM1	Graticule diameter:	100 µm
Laboratory location:	Base laboratory			Field blank:	Cowl C10 not counted		

Sample ref	Pump ID	Cowl ID	Time on	Time off	Duration (mins)	Flow rate (litres/min)		Volume (litres)	Fibres	Fields	Calculated result (f/ml)	Limit of quantification (f/ml)	Reported result (f/ml)
						Start	End						
1	SP6	C11	0900	1000	60	8.0	8.0	480	1.0	200	0.001	0.01	< 0.01
2	SP7	C12	0902	1002	60	8.0	8.0	480	0.0	200	0.000	0.01	< 0.01
3	SP17	C13	0903	1003	60	8.0	8.0	480	0.0	200	0.000	0.01	< 0.01
4	SP18	C14	0904	1004	60	8.0	8.0	480	1.0	200	0.001	0.01	< 0.01
5	SP20	C15	0905	1005	60	8.0	8.0	480	1.0	200	0.001	0.01	< 0.01
6	SP21	C16	0906	1006	60	8.0	8.0	480	0.0	200	0.000	0.01	< 0.01
7													
8													
9													
10													
11													
12													

Notes/comments:	All test results below the limit of quantification
-----------------	--

Analysed by:	Geraint Sage	Authorised signatory:		Issue date:	01/06/21
--------------	--------------	-----------------------	--	-------------	----------

Unit 22 Brynmenyn Business Centre St Theodore's Way Brynmenyn Industrial Estate Bridgend CF32 9TZ


Tel: 01656 720 293 info@bridgendasbestos.co.uk www.bridgendasbestos.co.uk

Registered in England & Wales Number 4817052. Registered office: 41 Chestnut Drive Porthcawl CF36 5AD

Appendix 1. Photographs



1. Sample 1, Ground floor, foyer

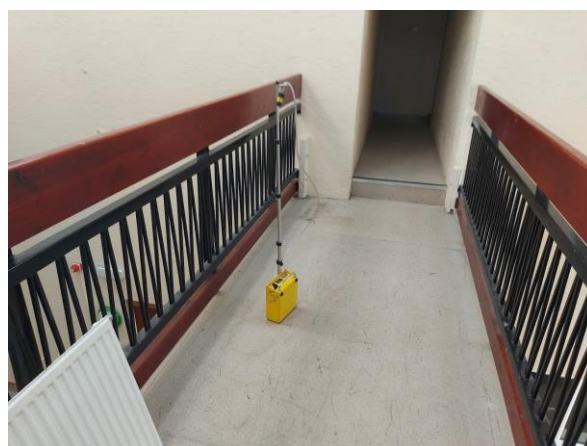


2. Sample 2, First floor, hallway




3. Sample 3, Flat 4



4. Sample 4, Flat 6

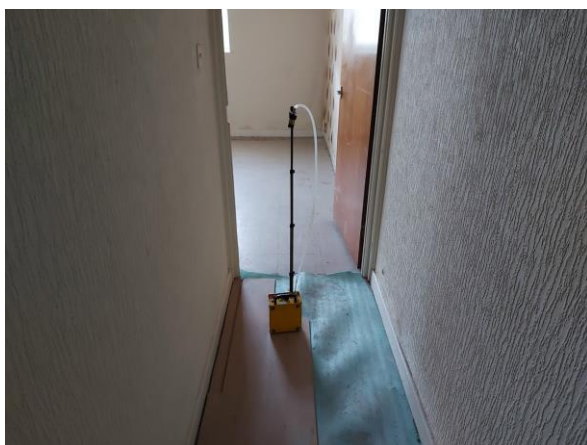

5. Sample 5, Flat 11

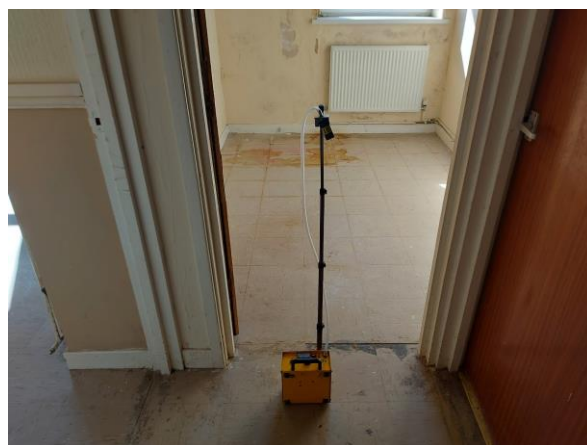

6. Sample 6, Flat 13